


REVISIONS			
NO.	DATE	BY	REMARKS
1	5-30-85	L.R.H.	REMOVED DIV. OF PUBLIC WORKS (T.BLK.)
2	7-23-87	D.H.G.	ADD: CLASS 'A'
3	3-10-88	D.H.G.	REMOVED DEPARTMENT (T.BLK.)

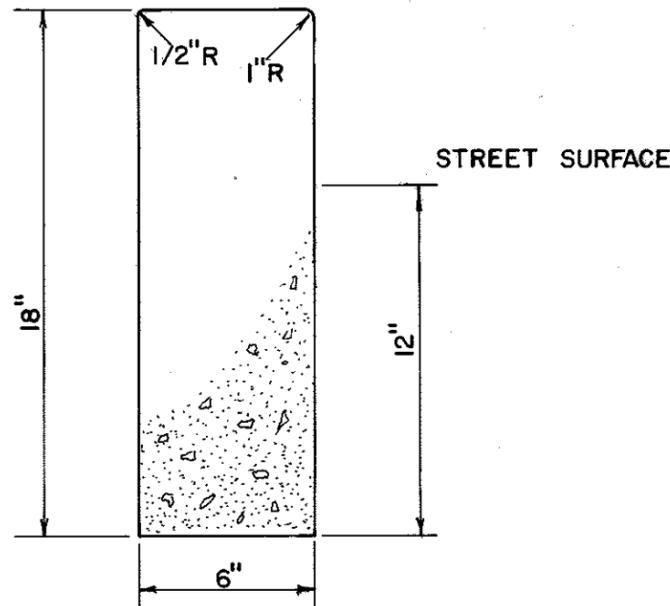

NOTES:

1. EXP JOINTS SHALL BE LOCATED AT ENDS OF RADIUS.
2. EXP JOINTS SHALL BE INSTALLED AT 40 ft., MAX.
3. EXP JOINTS SHALL BE LOCATED A MIN. OF 5 ft. FROM INLET STRUCTURE.
4. PRE-CUT EXP JOINT MATERIAL SHALL BE USED IN ALL EXP JOINTS.

CONCRETE TO BE CLASS 'A'

CITY OF MEMPHIS
DIVISION OF ENGINEERING

**DESIGN STANDARD
FOR
6" x 18" VERTICAL CURB**

Martin L. Jacobs 6/6/84
CITY ENGINEER DATE

DWG. NO. 42